


LET	REVISION	DATE
A	SUPERSEDES DWG SAME # DATED 5-87	8-30-93
B	ADDED 200" SCALE	8-20-98

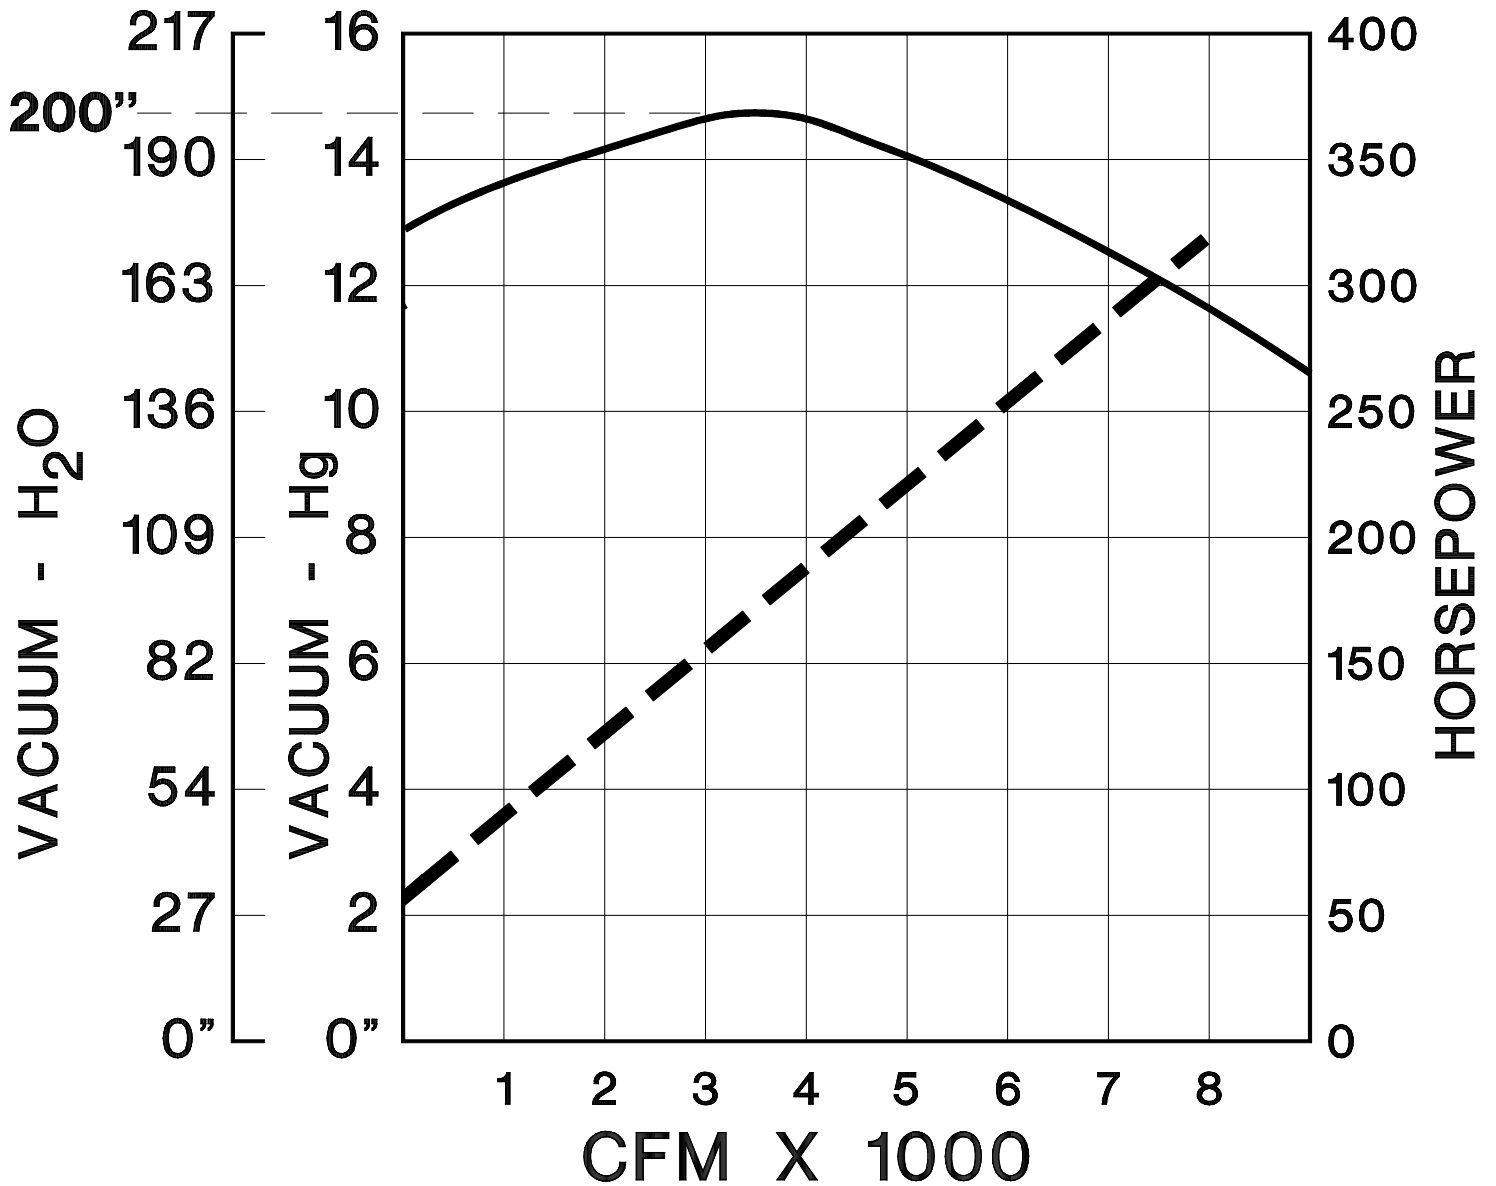

**4800 RPM MAX (AS TESTED)**

———— VACUUM      - - - - - HORSEPOWER

Fan curve adjusted for standard air (0.075 lbm/ft<sup>3</sup>, 29.92 in/hg, 70°F, sea level).

TEST CONDUCTED AND CERTIFIED BY FRANK BLEIER, CERTIFIED INDUSTRIAL PHYSICIST AND PROFESSIONAL ENGINEER REGISTERED ILLINIOS NUMBER 8526, DATED 2-8-63.

DRAWN POP	DATE 8-30-93	3 STAGE FAN VAC COMPRESSOR OPERATING CURVE	NEXT ASSEMBLY	QTY
	SCALE 1=1		WEIGHT LB	<b>VAC-CON</b>
		MATERIAL	GREEN COVE SPRINGS, FLORIDA USA	
			EFFECTIVE WITH VAC-CON SERIAL NUMBER	
			700A0024S	REV B